CITY ORDINANCE

All irrigation systems shall be provided with a switch which prevents the irrigation system from operating when the temperature drops below 38 degrees f.

All irrigation systems shall be separated from the potable water system by a listed double check assembly.

Six (6) inches of pea gravel shall be placed beneath but not within one (1) inch of the double check assembly in the entire vault area.

All double check assemblies must be installed inside a jumbo meter box measuring fourteen (14) inches by twenty (20) inches. Meter side of double check must be connected with copper.

Double Check Assembly

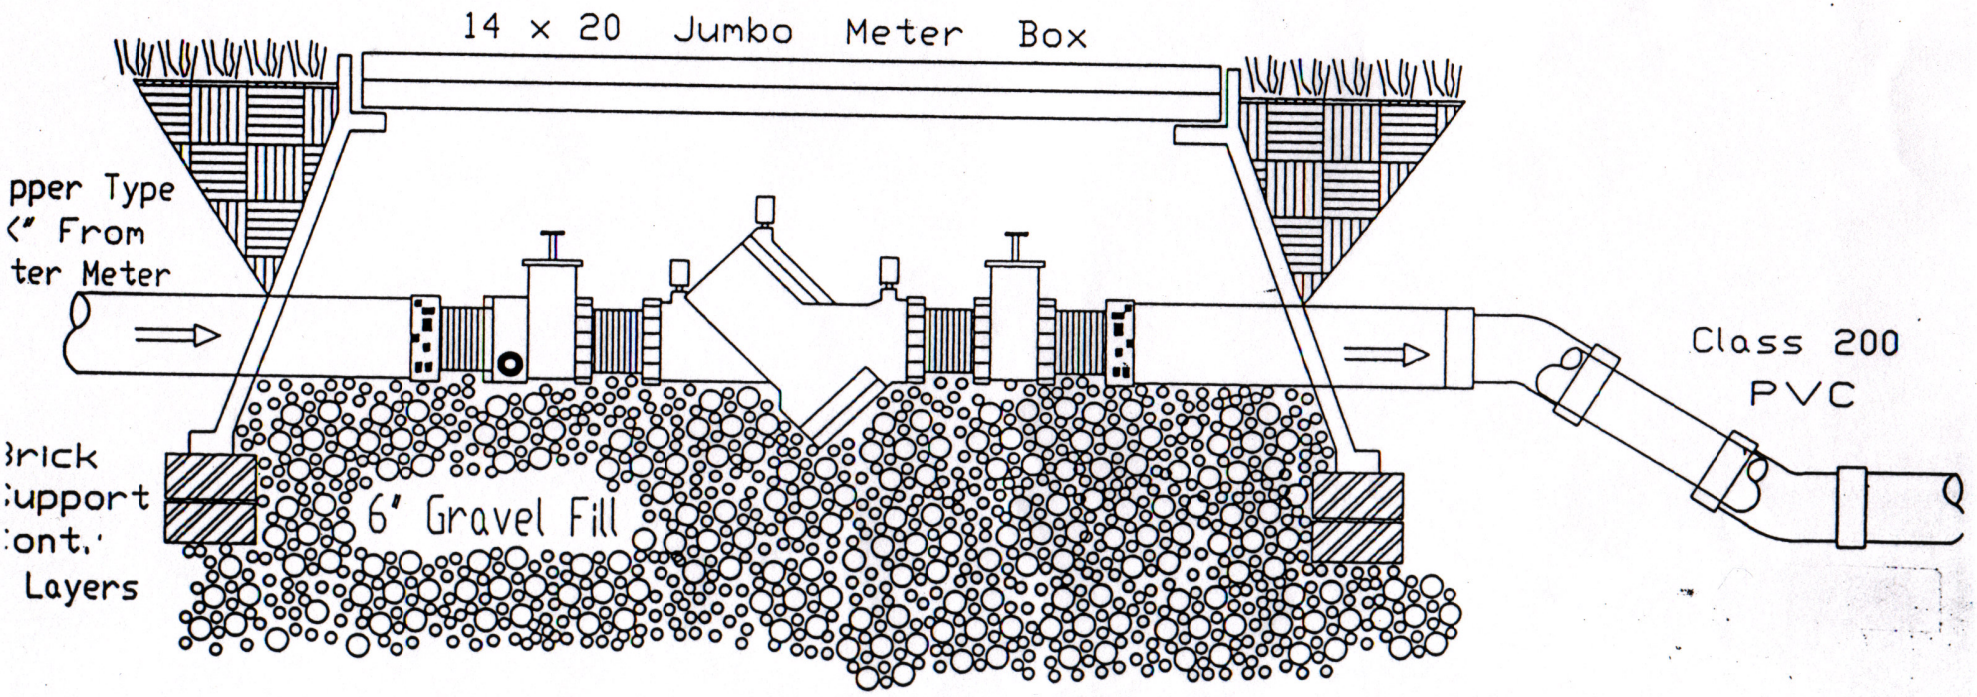

Gravel Fill to Extend Under Brick Support